



# The Standards Institution of Israel


This is to certify that: 5kW 32-42 Vdc Electrochemical Generator

Models: G5, G5.2

Electrical ratings: Output: 30-42Vdc, 5kW, max. 200A

Manufactured by: GenCell Ltd.

Address: 7 Hatnufa St., Petah Tikva 4951025, Israel

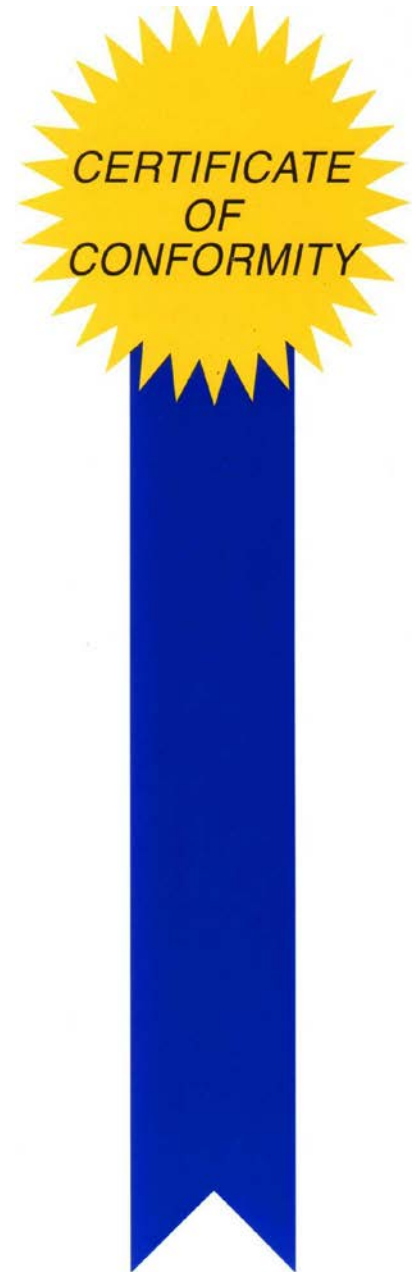

has been tested by SII and found to comply with the standard requirements of:

- ◀ IEC 62282-3-100: 2012 /
- ◀ EN 62282-3-100: 2012  
*Fuel cell technologies –  
Part 3-100: Stationary fuel cell power systems – Safety*
- ◀ IEC 60950-1:2005 (2nd Ed.) + Am 1:2009 /
- ◀ EN 60950-1: 2006 + A11: 2009 + A1: 2010 + A12: 2011  
*Information technology equipment — Safety —  
Part 1: General requirements*
- ◀ IEC 60204-1: 2005 + A1: 2008 /
- ◀ EN 60204-1: 2006 + A1: 2009  
*Safety of machinery - Electrical equipment of machines -  
Part 1: General requirements*
- ◀ IEC 60335-1: 2010 /
- ◀ EN 60335-1: 2012  
*Household and similar electrical appliances — Safety —  
Part 1: General requirements*

Test results are detailed in SII Test Report No.: 9312331906M1.

Certificate No.: 9312331906M1

Date of issue: 29/06/2017

  
Vladimir Chernikh  
Senior Safety Compliance Engineer  
Electrical Safety Branch  
Electrical and Electronics Laboratory